



**OFFICE OF THE SUPERINTENDENT BHIMA BHOI
MEDICAL COLLEGE & HOSPITAL**

At/PO/Dist – Balangir, PIN – 767001 (Odisha)

E-mail: gmchospitalbalangir@gmail.com



Tender Ref. No. 2544 /Estt.(BBMC&H),

Dt. 28-5-2021

**SHORT TENDER CALL NOTICE FOR INSTALLATION OF 32 BEDDED ICU
ORTHOPEDIC, 10 BEDDED ICU AND 10 BEDDED HDU IN EYE AND ENT UNIT AND
PROVISION OF CENTRAL OXYGEN GAS PIPE SUPPLY SYSTEM TO MEDICINE WARD
(Male &Female), PSYCHIATRY AND ISOLATION WARDS OF BHIMA BHOI MEDICAL
COLLEGE & HOSPITAL, BALANGIR**

Date of Publication of Bid	:	28.05.2021
Last Date Of Receipt Of Bid Documents	:	04.06.2021
Date and Time of Pre-Bid Meeting	:	03.06.2021
Date and Time of Opening Technical Bid	:	05.06.2021 at 11.00am
Date of Opening Financial Bid	:	Intimated later.

Place of opening of Tender &
Address For Communication

: Superintendent, Bhima Bhoi Medical Collage
& Hospital, District-Balangir.

Sd/

[Handwritten Signature]
28-05-2021
Superintendent
Bhima Bhoi Medical College & Hospital
Balangir - 767001

SHORT TENDER NOTICE DOCUMENT

Sealed quotations are invited from intending firms of repute/ Supplier installation of 32 bedded ICU orthopedic, 10 bedded ICU and 10 bedded HDU in EYE and ENT unit and provision of central oxygen gas pipe supply system to medicine ward (male & female), psychiatry and isolation wards of Bhima Bhoi Medical College & Hospital, Balangir. In case of any bid amendments and clarification, responsibility lies with the bidders to collect the same from the website or the office notice board before last date of purchase of tender document and the Superintendent shall have no responsibility for any delay / omission on part of the bidder.

The tender will be rejected if the bidder changes any clause or Annexure of the bid document downloaded from the website.

A. ELIGIBILITY CRITERIA

The firms having experience in this field are eligible to participate in tender provided they have to submit the following documents:

- (i) Copy of GST registration.
- (ii) Drug license for manufacture of oxygen gas.
- (iii) Price bid (as per Annexure- I).
- (iv) Details of address, contact no. of responsible person, email, fax etc.

B. REJECTION OF THE QUOTATION/BID:

The tender paper will be rejected if any of the following documents are wanting / not found with the tender bid:

- (i) Non submission of relevant documents
- (ii) Price bid/ quoted rate with signature and seal of authorized person of the firm.

C. EVALUATION:

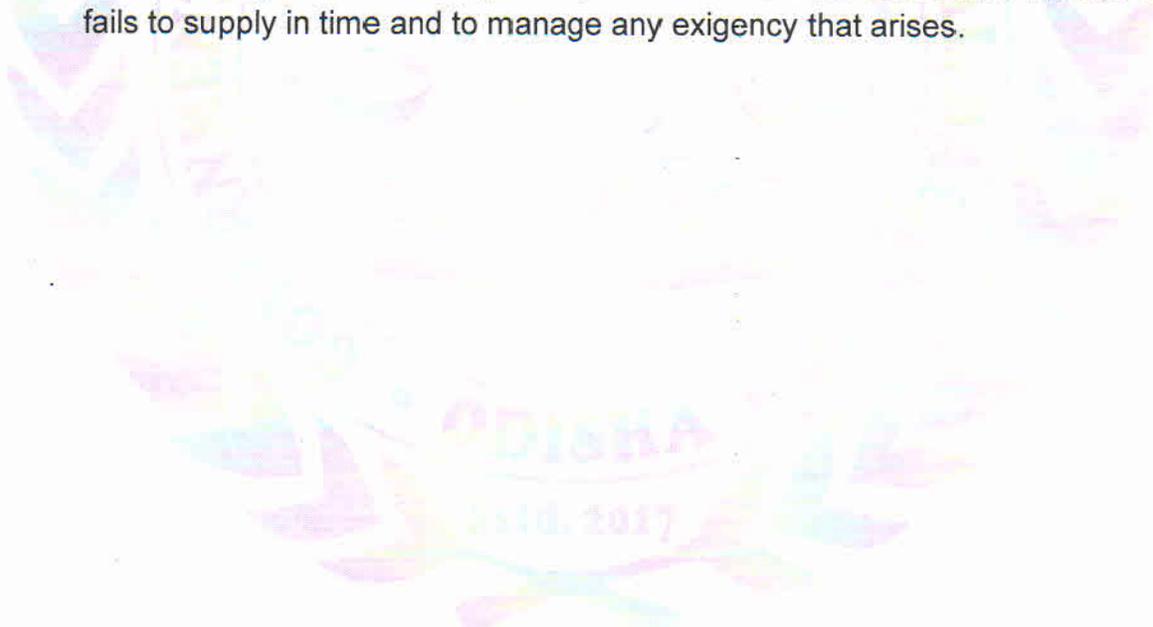
1. The tender paper will be evaluated as per requirement of the bid and the price bid will be opened only for the bidders who qualified in the document evaluation.
2. The cost of the unit item excluding GST will be evaluated.
3. If the approved lowest eligible supplier fails to supply items in time, to meet the requirement the same shall be procured from the L2/L3 suppliers at L1 rate, if they agree to supply at L1 approved rate.
4. However, the authority reserves the right to negotiate with the L2 bidder to match the L1 price for steady and continuous flow of oxygen and other gases for the interest of the patients in case of exigency.

D. PAYMENT:

1. 100% payment on monthly basis shall be made after submission of stock entry certificate from the concerned authority and as per the availability of funds. UNDER NO CIRCUMSTANCES THE SUPPLY SHOULD BE INTERRUPTED / STOPPED BECAUSE OF DELAY IN PAYMENT.

E. GENERAL CONDITIOS:

1. The Bids documents should be clearly written / typed without any correction, interpolation and overwriting. Each page of the tender should bear the dated signature of the tenderer.
2. All the pages of the tender document should be numbered and self-attested. Of any information or documents furnished by the tenderer found to be misleading / incorrect at any stage, their tender will be rejected.
3. The approved rate and supplier will be valid for one year from the date of approval and may be extended on review on mutual agreement with the same terms and conditions subject to satisfactory performance of the approved supplier.
4. In the event of the last date of submission of bid date being declared as a holiday for the purchaser's office, the due date submission of bids and opening of bids will be the following working date & time.
5. The authority reserves the right to accept / reject all the bids or any part thereof without assigning any reason thereof.
6. All legal disputes, if any relating to purchase etc. are subject to jurisdictions in the court of law situated at Balangir or High court of Odisha.
7. The supply should not be interrupted due to any event or power failure. The firm should have responsibility to supply the items on his own arrangement in time.
8. The authority reserve the right to procure items from L2/L3 firm in case I1 firms fails to supply in time and to manage any exigency that arises.


25/5/2021
Superintendent
Bhima Bhoi Medical College & Hospital
Balangir - 767001

PRICE SCHEDULE

Sl. No.	Description of required items	Make in India or imported	Manufacture	Quantity (Nos. / Mtrs.)	Unit price	Amount	Remarks
1	SITC of Copper pipes of 28 mm OD x 0.9mmthk Medical Grade Copper Tubes/Pipes : it should be confirm and meet with BS:EN:13348:2018 copper pipes : All Medical grade degreased copper pipes must be inspected and duty duly Third party Certified by Govt. Registered firms. Medical pipes manufactured from phosphorous de-oxidize non arsenical copper manufactured to metric outside diameters and having mechanical properties in accordance with BS:EN: 13348:2018.						
2	SITC of copper pipes of 22 mm OD x 0.9 MM Thk, Medical grade Copper Tube/Pipes: it should be meets with BS:EN:13348:2018 COPPER PIPES: All medical grade degreased copper pipes must be inspected and duty Third party certified by Registered. Medical Grade copper pipes manufactured from phosphorous de-oxidized non arsenical copper manufactured to metric outside diameters and having mechanical properties in accordance with BS:EN: 13348:2018						
3	Imported Gas outlet Points (wall outlet/Console coutler: it should meet the requirements of NFPA and CSA, all outlets shall be cleaned and degreased from medical gas service, factory assembled and tested. The outlets are UL Listed and ETI, Listed Outlets shall be manufactured with a 7-3/4p (197mm) length type "K" 1/2 (12.7 MM)OUTSIDE DIAMETER (3/8" (9.5 mm) nominal) size copper inlet pipe piece brass construction for positive pressure gas service to a gas specified dual pin indexing arrangement on the respective identification module. A large colour coded front plate shall be used for easy of gas identification ad aesthetic appeal. with the back rough in mounted the outer shall adjusted up to 3/4 (19 mm) variation in mouing plate thickness. the large valve assembly shall be quick disconnect and accept only corresponding purian -Bennet type gas specific adapters. Indexed to eliminate interchangability of gas services purtan - Bennet type gas specific adapter. Indexed to eliminate interchangability of gas services puritan bennet type gas specific adapter indexed to eliminate interchange ability of gas services up to 3/4"(19mm)mounting plate thickness. 360 degree swivel inlet pipe for easy installation.						
4	Gas Outlet points for Oxygen						
5	Gas Outlet points for Air-4bar						
6	Gas Outlet points for Vacuum						

7	SITC of Imported 3 Gas Area Alarm (Oxygen, Air 4 Bar and Vacuum): It should meet the requirement of NFPA and CSA. Area alarm should provide with an LED Digital readout comprising of 0-250 psi(0-1.724kPa) for pressure and 0-3 inHg (-100-0 HgkPa) for vacuum. The digital read out shall provide constant indication of each service being measured. It will indicate a green "NORMA" Red "HIGH" or "LOW" alarm condition. If an alarm occurs the RED alarm light shall flash and the audible alarm will sound. Pushing the "alarm mute" button will cancel the audible alarm. But the unit remain in the alarm condition until the problem is rectified. It should be digital LED read out with red alarm. Normal green indicator of each service. It should be sensor housed in a solid temper proof barrier against any interference.						
8	SITE of imported sensors shall be mounted locally (in the rough in box) by installing the copper pipe provided or mounted remotely, Sensors will be automated for gas specific detection each sensor unit is gas specific, with an error message display for an incorrect connection. LCD Sensor operating pressure range Mid pressure: (0 psi to 99psi)OXY, Air, Vacuum(0 to 30 in HG- VAC						
9	SITE of Oxygen fully automatic control panel of 2000ipm: it should fully compile and meet with the requirements of NFPA-99 standards. It should be UL or ETL listed. The manifold control panel shall consist of two bank regulators (dome bias) used to deduce the cylinder pressure to the two line regulators with in turn controls the final line pressure. the manifold has an intermediate and line relief valve that is internally connected to a common vent port terminating in to a 1/2" FNPT pipe. it should be fully automatic type and shall be with from bank in use to reserve Bank.						
10	SITE of Oxygen manifold (10+10 size): Oxygen main Manifold (10+10 with 20 nos of pig tail pipes & 20 nos of non-return valve						
11	SITC of free standing cylinder Manifold stand						
12	SITC of Stainless Steel probe						
13	SITC of Oxygen Flow meter						
14	SITC of Humidifier bottle						
15	SITC of imported ball valve / Isolation valves for 22 mm						
16	SITC of imported Ball Valve / Isolation valves for 28 mm						
17	SITC of Vacuum Regulator						
18	SITC of 600 collection jar with lid and bracket clamp						

Date :

Signature of the bidder with seal

Page 5 of 5

[Handwritten Signature]
 Superintendent
 Bhima Bhoi Medical College & Hospital
 Balangir - 767001